


SERVICE ENTRANCE/UNDERGROUND CABLE SIZE CHART		
AMPS	COPPER	ALUM.
100	#4	#2
150	#1	#2/0
200	#2/0	#4/0

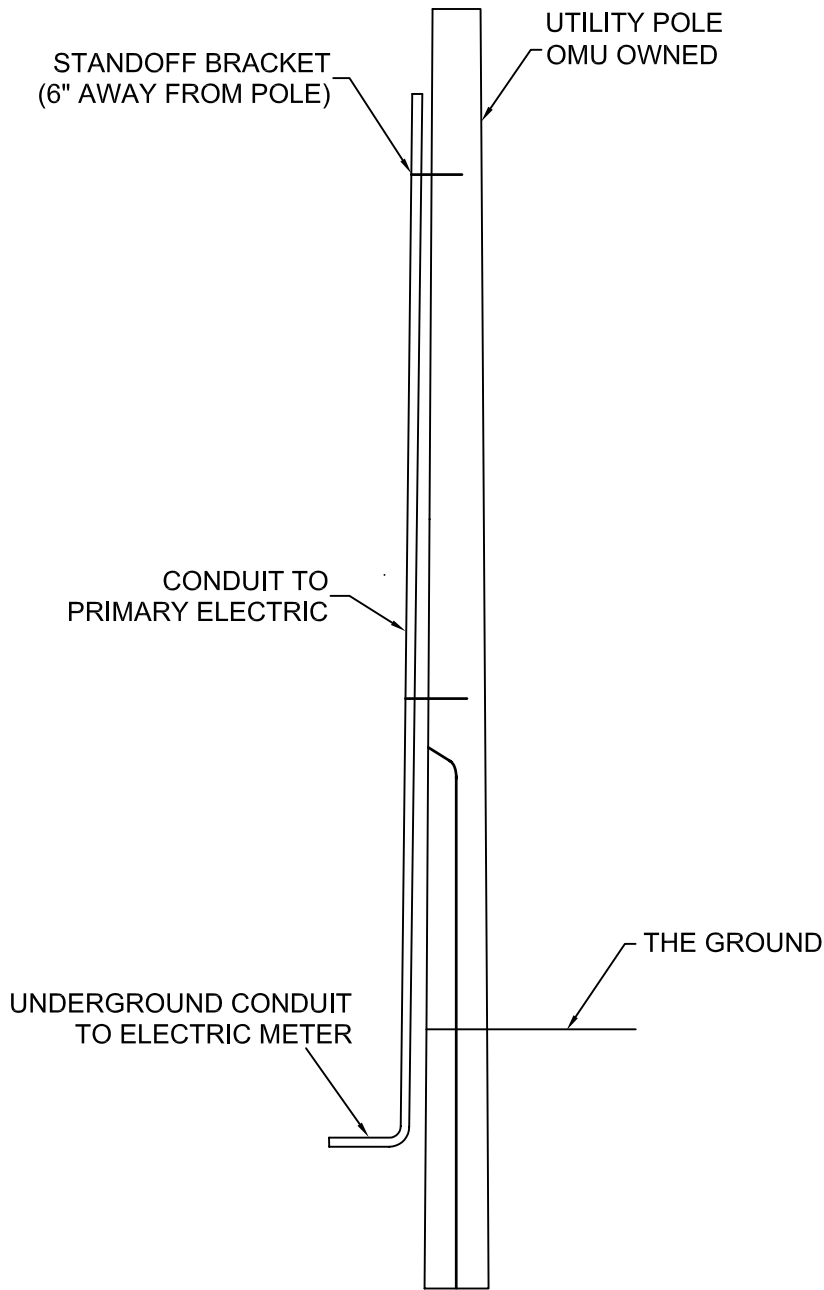

NOTES:

1. CONDUCTOR CONDUIT AND GROUNDS TO MEET N.E.C.
2. SERVICE MUST BE INSPECTED BY COUNTY ELECTRICAL DEPARTMENT

ITEM	QTY.	MATERIAL	ITEM	QTY.	MATERIAL
1			1		
2			2		
3			3		
4			4		
5			5		
6			6		



STANDARD URBAN UNDERGROUND HOUSE SERVICE INSTALLATION

DWG NO.	CAD FILE	DWG BY
EP-011807-2	EP011807-2.dwg	DL
DATE	SCALE	Construction Standard
1-18-2007	NONE	